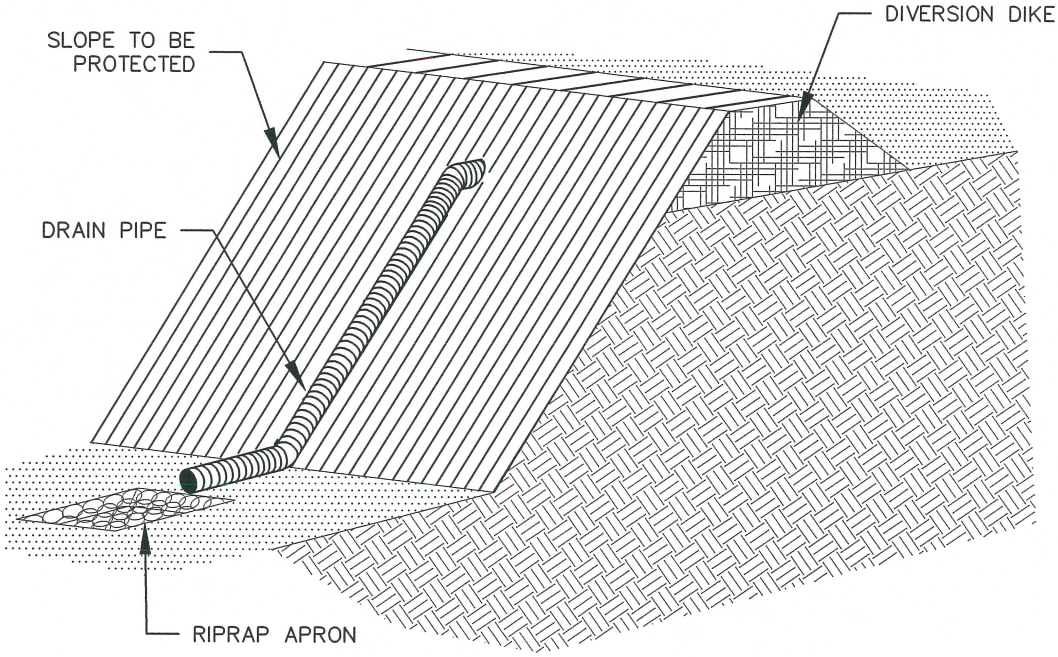

ISOMETRIC PLAN VIEW
N.T.S.

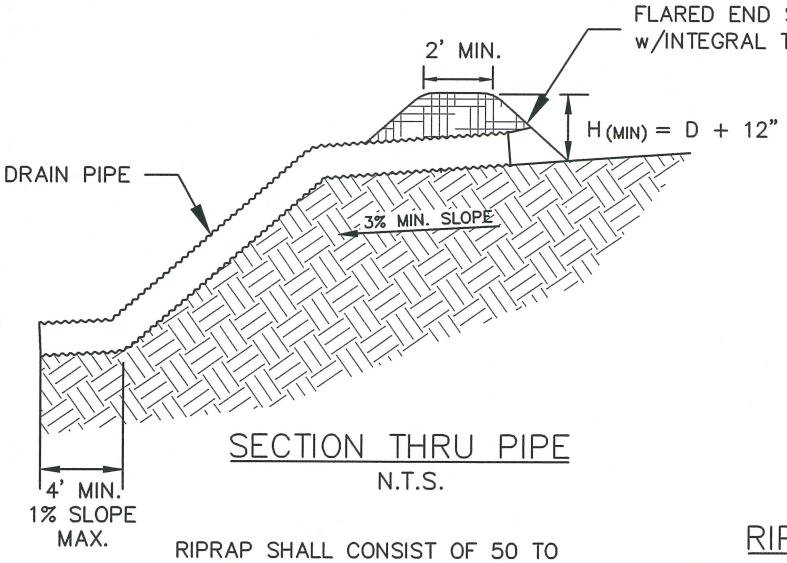

SECTION THRU PIPE
N.T.S.

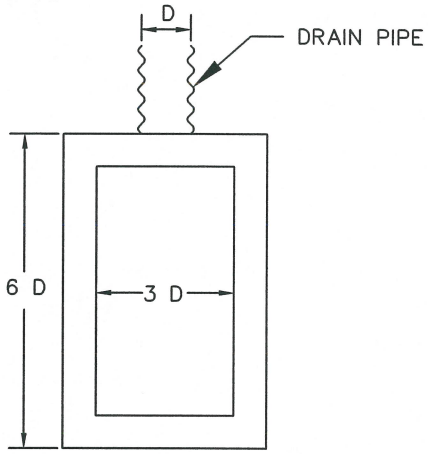

RIPRAP APRON PLAN VIEW
N.T.S.

RIPRAP SHALL CONSIST OF 50 TO 150 POUND STONES PLACED IN A LAYER OF NOT LESS THAN 12 INCHES. THE DEPTH OF THE APRON SHALL EQUAL THE PIPE DIAMETER BUT IN NO CASE SHALL IT BE LESS THAN 12 INCHES.

DISCLAIMER:
The use of this standard is governed by the City of Wichita Falls Engineering Department. No warranty of any kind is made by the City of Wichita Falls for any purpose whatsoever. The City of Wichita Falls assumes no responsibility for the conversion of this standard to other formats for incorrect results or damages resulting from its use.

Wichita Falls TEXAS

Pipe-Slope-Drain.dwg
ACAD DRAWING NAME

NOV 03
DATE DRAWN

1110-00
STANDARD DRAWING NO.

NO.	DATE	DESCRIPTION	BY

R E V I S I O N S

CITY OF WICHITA FALLS, TX

PIPE SLOPE DRAIN

APPROVED

Jeffery A. Hogan, P.E.
CITY ENGINEER

NOV 2003
DATE